

NELSON™ HEAT TRACING SYSTEMS

INSTALLATION

ALT-LPM POWER CONNECTION KIT WITHOUT ENCLOSURE


INSTRUCTIONS

DESCRIPTION

The ALT-LPM Power Connection Kit without Enclosure is constructed of cast aluminum for use with all versions of Nelson Heat Tracing Systems' LT, HLT & NC heater cables. Compatible for use with any vendor's heater cables smaller than 11mm (0.44") diameter. Minimum installation temperature -40°C (-40°F).

KIT CONTENTS

- | | |
|-------------------|---------------------|
| 1 Sealing Grommet | 1 Power Termination |
| 1 Stand-off | 1 Terminal Block |
| 1 End Seal | 1 Gasket |
| 1 Ground Screw | 1 Tube of Silicone |
| 1 Conduit Locknut | 1 Box Adapter |

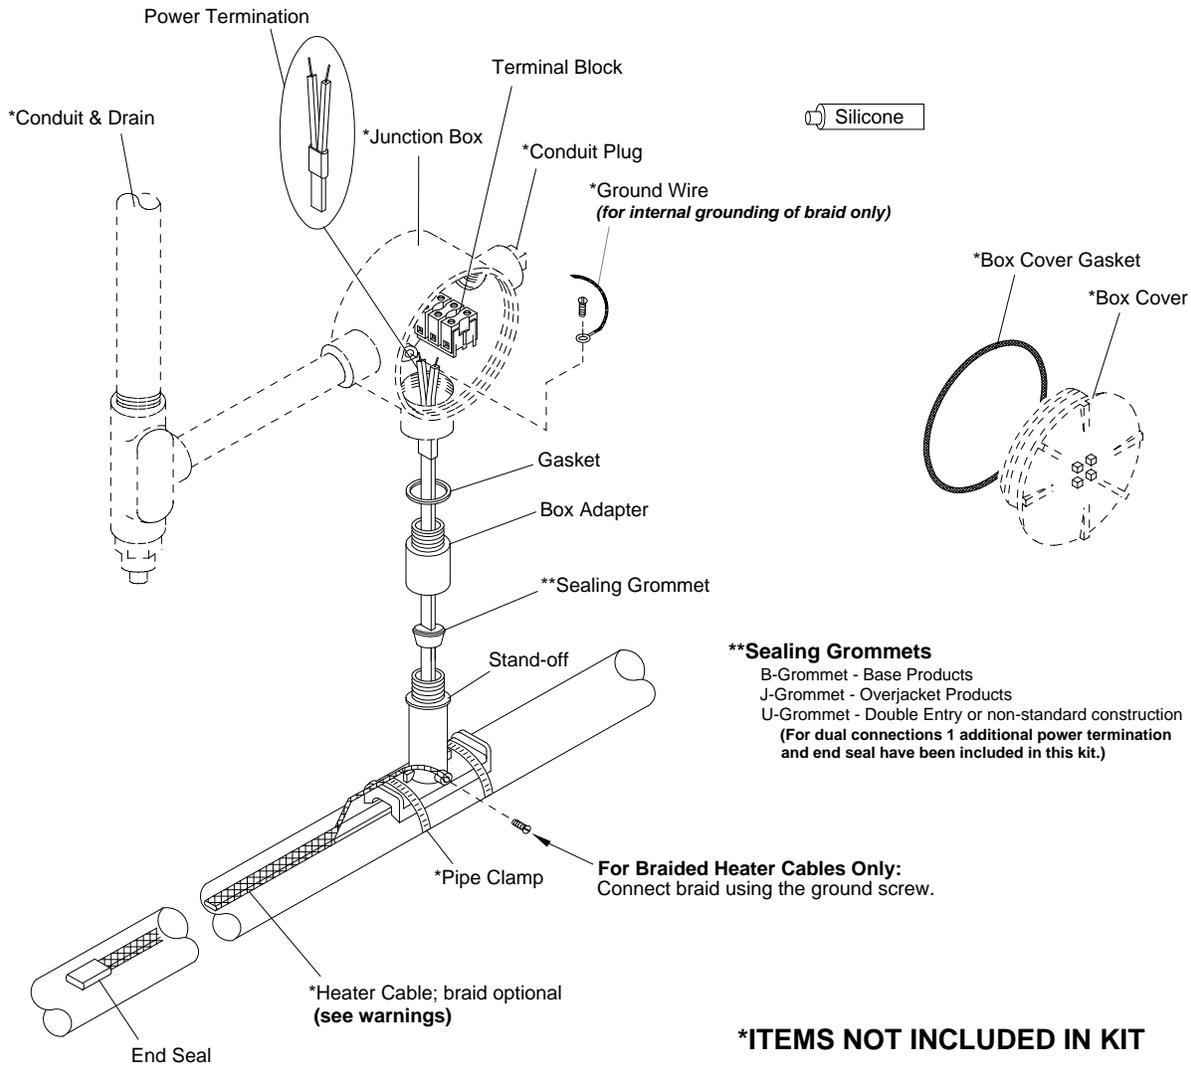

Note: This detail shows external grounding of braid. For internal grounding of braid

⚠ WARNINGS:


- Canadian Div. 2 Hazardous installations must use internal ground connection of braid. *See sheet 8.*
- Article 427 of the National Electric Code requires that all heaters shall have metal coverings and be provided with branch circuit ground-fault protection.
- If nuisance tripping of ground fault breakers occurs due to condensation in junction box, electrical connections should be moisture proofed by use of a coating or sealant.

(overjacket products), see sheet 8.

STAND-OFF POSITIONING


Section View A A

(recommend installing at the
 4 or 8 o'clock positions)



⚠ WARNING:


**Do not place pipe clamps
 over the heater cable.**

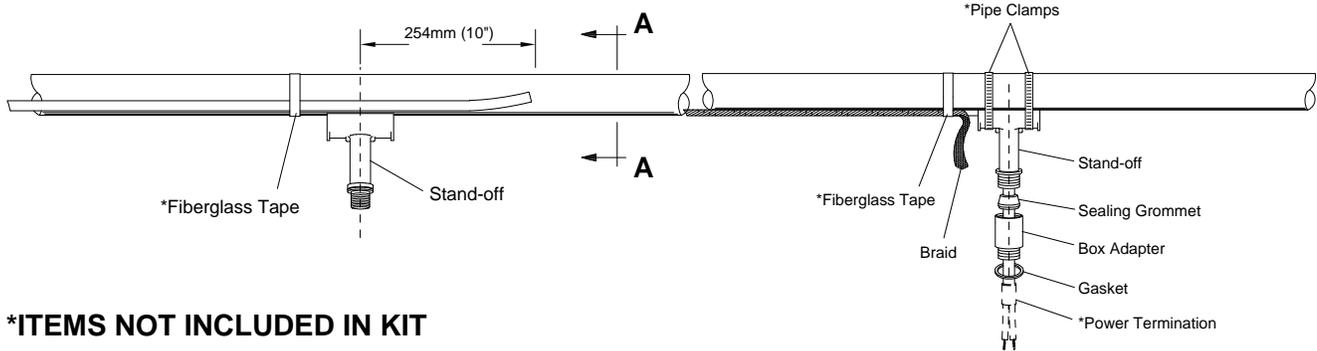


***ITEMS NOT INCLUDED IN KIT**

1. Mark pipe where stand-off will be mounted.
2. **For External Braid Connection - CB Products only:**
 - Remove braid from heater cables, back to the point the cables leave the pipe. See Sheet 3.
 - Proceed to step 3 below.
- For Internal Braid Connection - CB, J or JT Products:**
 - Proceed to step 3 below.
3. Push heater cable through the bottom opening of stand-off.
4. Place stand-off on pipe and fasten with pipe clamps.
5. Slide the sealing grommet over heater cable and position inside stand-off opening.
6. Apply silicone around the heater cable on top of the sealing grommet and fill any voids in sealing grommet.
7. Slide the box adapter over the heater cable and tighten securely to stand-off.
8. Prepare heater cable for power termination:
 - for braided products, see sheet 3.
 - for overjacket products, see sheet 4.
 - for base products, see sheet 5.
9. Terminate heater cable, see sheet 7.


BRAIDED PRODUCTS
(for external braid connection only)

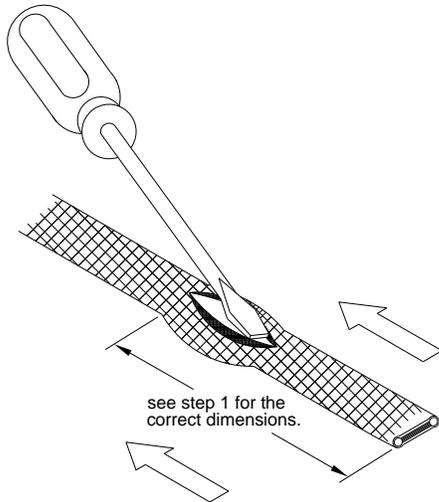

- 1) **For External Braid Connection:**
Move braid back 305mm (12") to create a bulge.
- 2) **For Internal Braid Connection:**
Move braid back 127mm (5") to create a bulge.
- 3) At the bulge, separate the braid to make an opening.

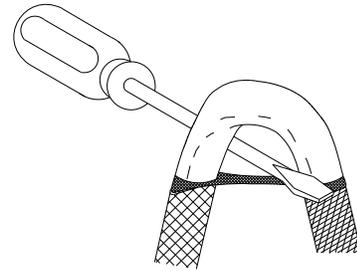


- 4) While bending the heater cable, work it through the braid opening.

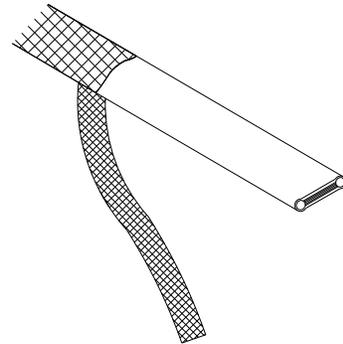


- 5) Pull the braid tight.
- 6) Proceed to "Base LT & HLT Products", sheet 5.


OVERJACKET PRODUCTS

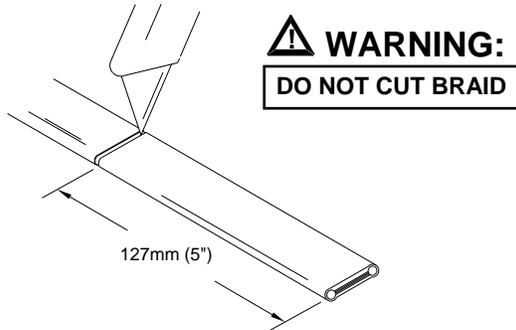


- 1) Lightly cut around heater overjacket 127mm (5") from the end. Bend cable to break overjacket.
- 2) Lightly cut overjacket up the center between first cut mark and the cable end. Bend cable to break overjacket.

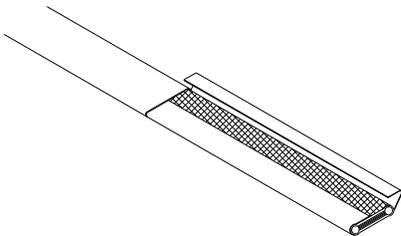


- 3) Remove overjacket from heater cable.

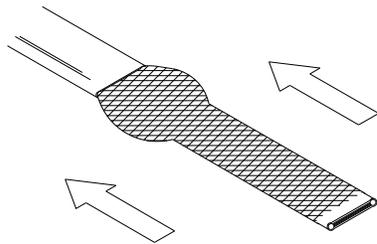


- 4) Move braid back toward the overjacket, creating a bulge.

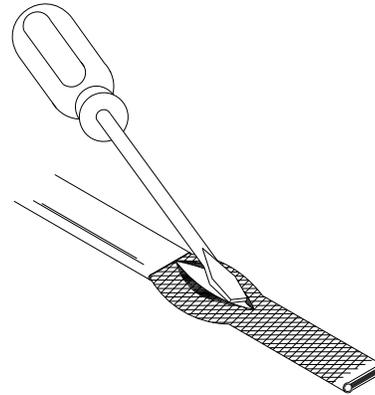

- 5) At the bulge, separate the braid to make an opening.

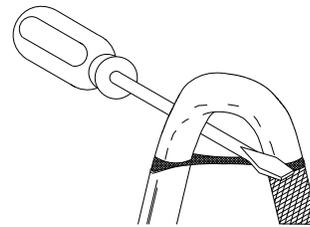


- 6) While bending the heater cable, work it through the braid opening.

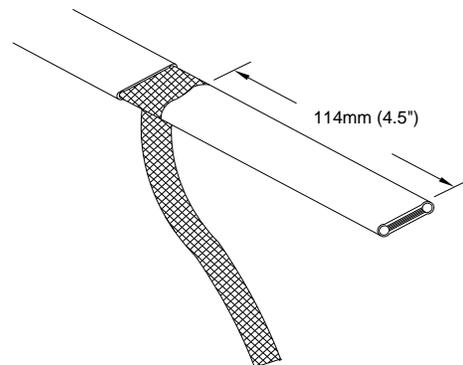


- 7) Pull the braid tight.
- 8) Proceed to "LT, CLT & HLT Products", sheet 5.


FOR ALL NELSON LT, CLT & HLT PRODUCTS
(See sheet 6 for an alternate method of HLT products.)

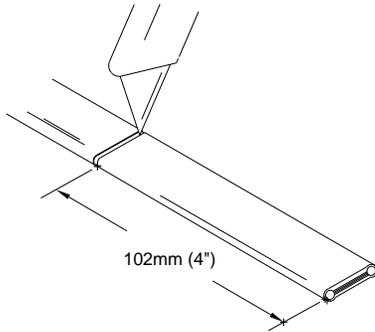


- 1) Lightly cut around heater outer jacket 102mm (4") from the end. Bend cable to break outer jacket.
- 2) Lightly cut the outer jacket up the center between the first cut mark & the cable end. Bend cable to break outer jacket.

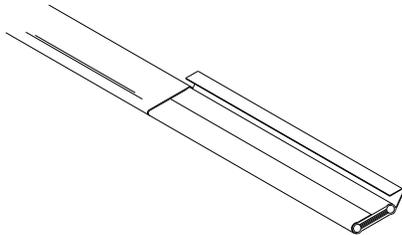


- 3) Remove the jacket from the heater cable.

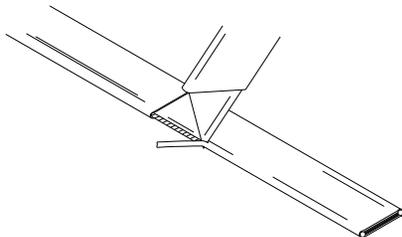

- 4) Shave the core material from the outside of each bus wire.

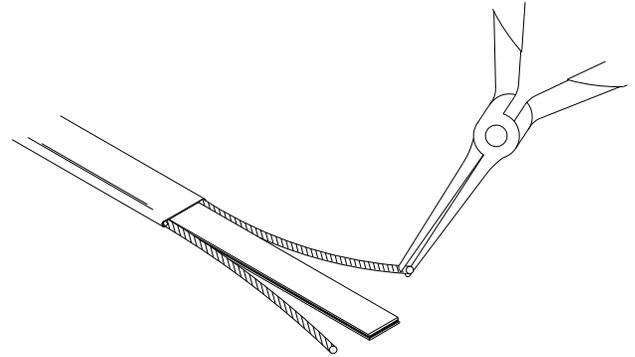


- 5) Starting at the end, pull each bus wire away from the core material.
- 6) Remove exposed core material.

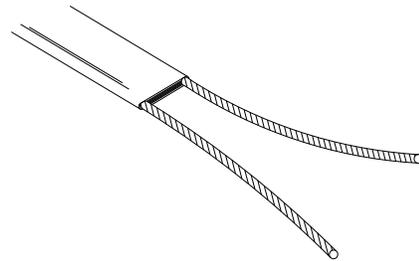

- 7) Cut 6mm (0.25") off the end of each bus wire.
- 8) Proceed to "Power Termination", sheet 7.


⚠ WARNING:
DO NOT CUT BUS WIRES.

HLT PRODUCTS
ALTERNATE METHOD

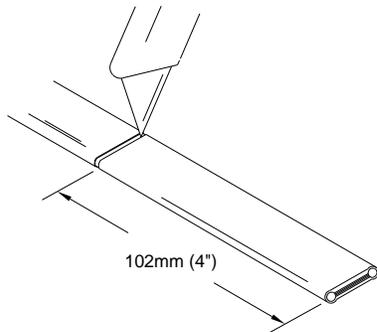


- 1) Lightly cut around heater outer jacket 102mm (4") from the end. Bend cable to break outer jacket.


- 2) Lightly cut the outer jacket up the center between the first cut mark & the cable end. Bend cable to break outer jacket.

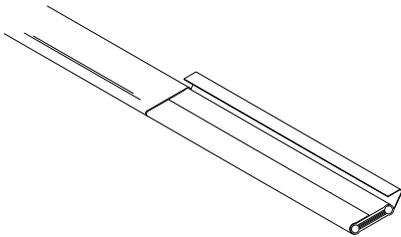


- 3) Remove the jacket from the heater cable.

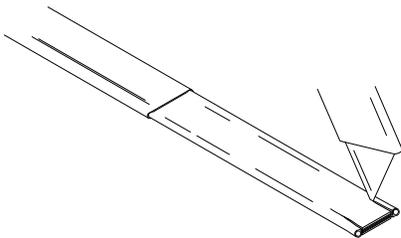


- 4) Make a cut inside each bus wire.

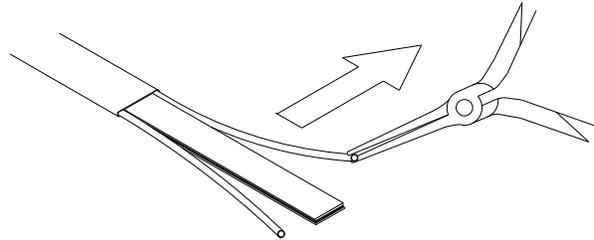

- 5) Starting at the end, in the same plane as the cable, pull each bus wire away from the core material.

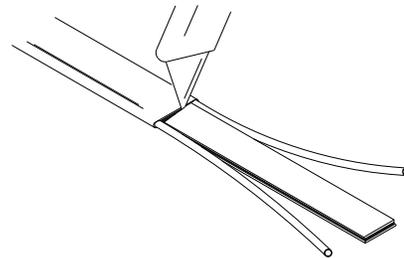

- 6) Remove exposed core material.

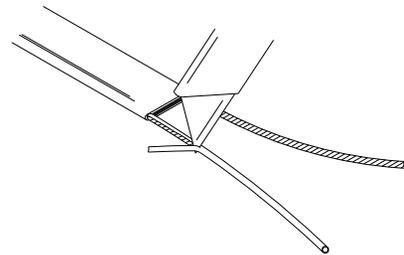


- 7) Remove the remaining core material off the outside of each bus wire.
- 8) Cut 6mm (0.25") off the end of each bus wire.
- 9) Proceed to "Power Termination", sheet 7.


POWER TERMINATION

⚠ WARNINGS:

- Bus wires must not touch or cross while inserting into power termination / end seal.
- Only power terminations / end seals specifically approved for the vendor's style and type of heater cable must be used.

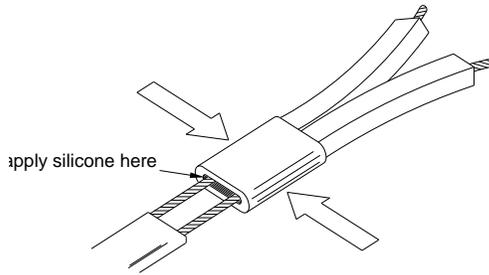


- 1) Insert bus wires into power termination.
- 2) Squeeze power termination opening and fill with silicone.

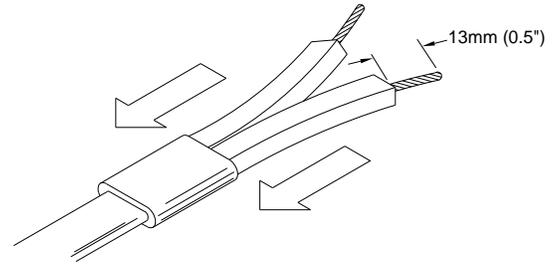

- 3) Push power termination to overlap jacket.
- 4) At this point, if you're installing the end seal, see the "End Seal" section below. Otherwise, proceed to "Power Connection", sheet 8.

END SEAL

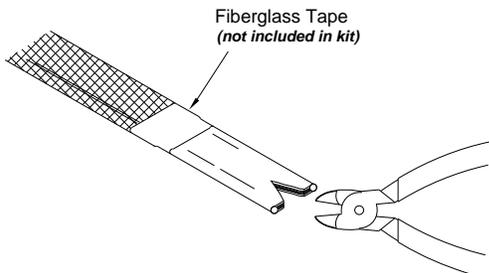


- 1) **For Braided Products:**
Cut braid back 25mm (1") & tape in place with fiberglass tape.

For Overjacket Products:

Remove 13mm (0.5") of overjacket exposing the braid, then remove the 13mm (0.5") of exposed braid.

- 2) Make a 10mm (0.4") cut at the end of the heater cable.

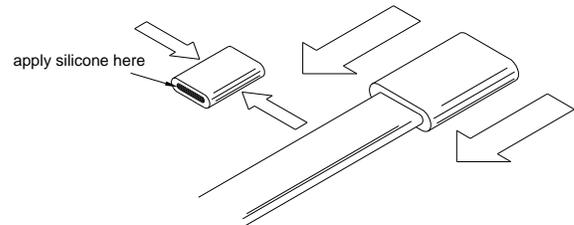

- 3) Squeeze the end seal and fill with silicone.
- 4) Push end seal over the heater cable.

For Overjacket Products:


The end seal should overlap the overjacket.

- 5) The silicone will set up in about 30 minutes with a complete cure after 24 hours.
- 6) Proceed to "Power Connection", sheet 8.


⚠ WARNINGS:

- Do not megger or hi-pot until silicone is completely cured.
- Braid must be kept away from bus wires or shorting will occur.

POWER CONNECTION

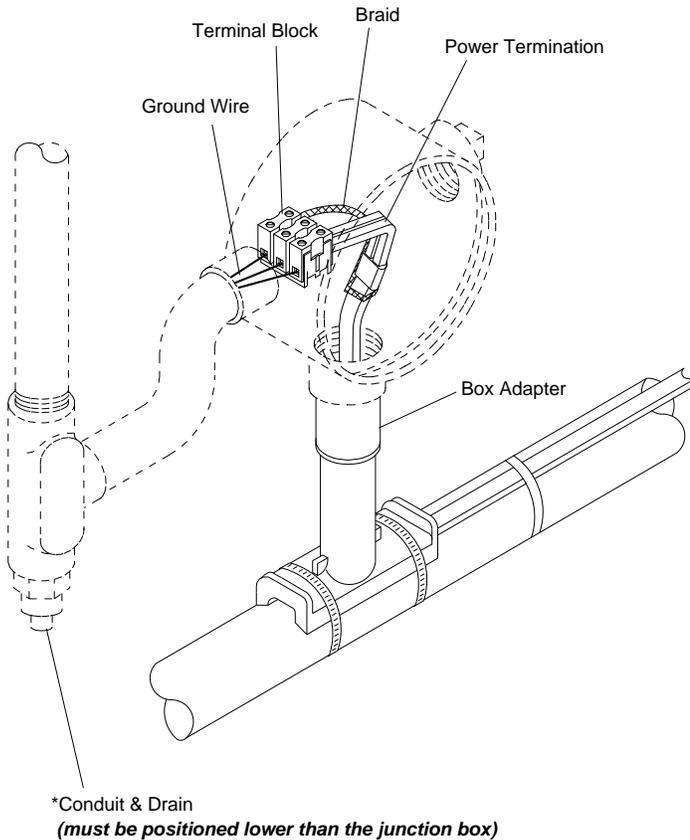

TERMINAL BLOCK CONNECTION



Note: This detail shows internal grounding of braid.

1. Place gasket on box adapter.
2. Secure junction box onto box adapter until tightly fitted. **DO NOT OVER TIGHTEN.**
3. Connect the power wiring and heater cable to terminal block.
4. Ground Connection:
 - For External Ground Connected Heaters:**
 - Connect ground braid to stand-off using the ground screw. *See diagram on sheet 1.*
 - For Internal Ground Connected Heaters:**
 - Connect ground wire to terminal block inside junction box using the ground screw. *See diagram on sheet 1.*
 - Connect ground wire and braid to terminal block. *See diagram above.*
5. **For Overjacket J or JT Products only:**
Apply silicone at point braid leaves the overjacket.
6. Push all wires and heater cable inside junction box.
7. Install box cover gasket and box cover onto junction box.

Nelson Heat Tracing Systems products are supplied with a limited warranty. Complete Terms and Conditions may be found on Nelson's website at www.nelsonheaters.com.