

NELSON™ HEAT TRACING SYSTEMS

PLT-LPM POWER CONNECTION KIT WITHOUT ENCLOSURE


INSTALLATION INSTRUCTIONS

DESCRIPTION

The PLT-LPM Power Connection Kit without Enclosure is for use with all versions of Nelson Heat Tracing Systems' LT, CLT, HLT and NC heater cables. Compatible for use with any vendor's heater cables smaller than 11mm (0.44") diameter.

KIT CONTENTS

1 Conduit Locknut	1 Power Termination
1 Sealing Grommet	1 Box Adapter
1 Stand-off	1 Terminal Block
1 End Seal	1 Gasket
1 Tube of Silicone	1 Uninsulated Splice Connector

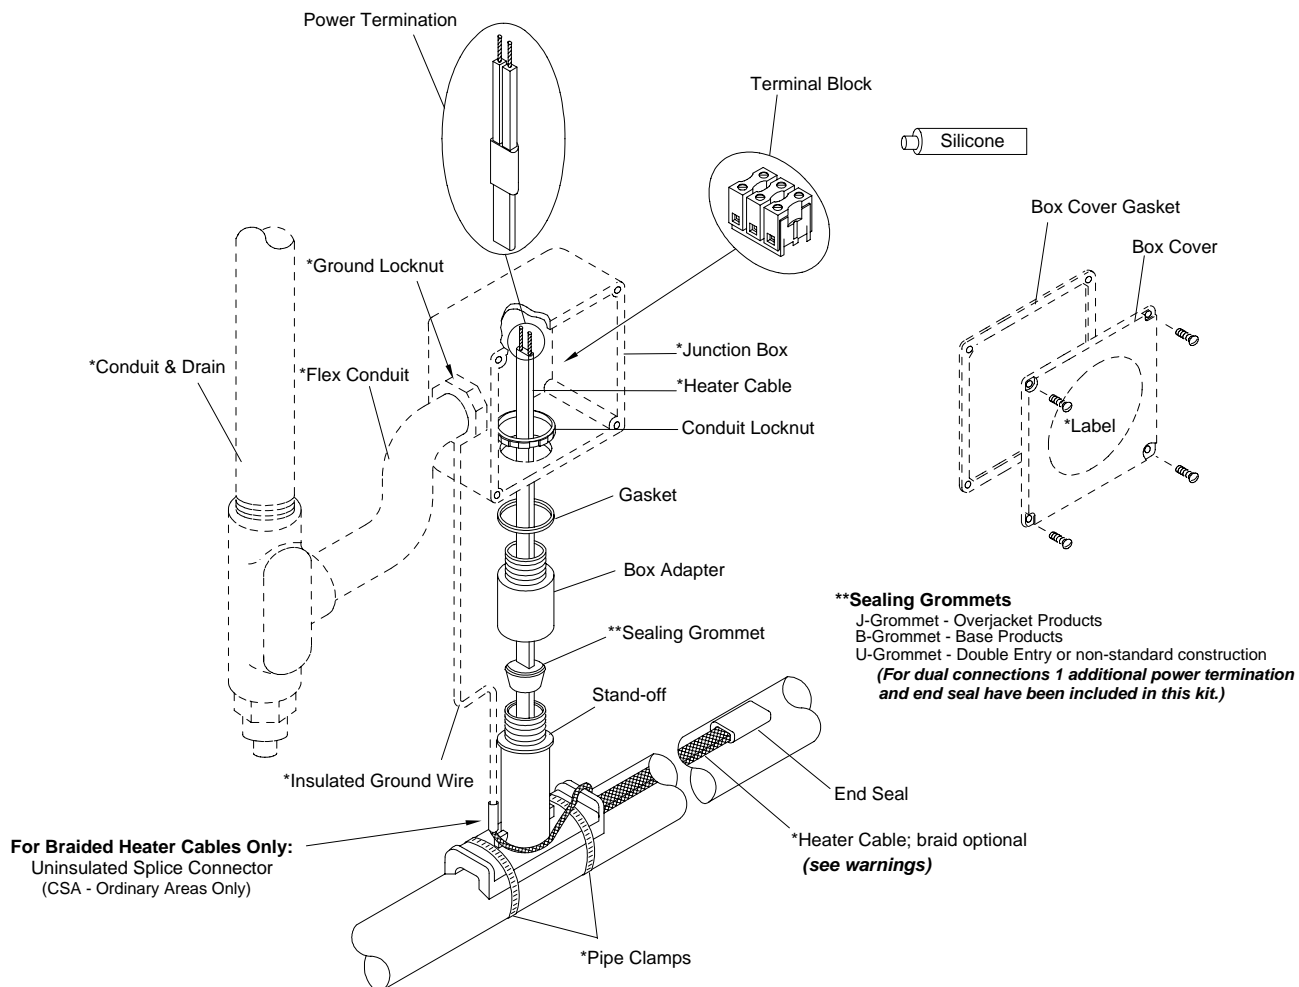

*ITEMS NOT INCLUDED IN KIT


(Customer supplied junction box must be approved for this application.)

Note: This detail shows external grounding of braid. For internal grounding of braid (overjacket product), see sheet 8.

WARNINGS:

- Canadian Div. 2 Hazardous installations must use internal ground connection of braid. See sheet 8.
- Article 427 of the National Electric Code requires that all heaters shall have metal coverings and be provided with branch circuit ground-fault protection.
- If nuisance tripping of ground fault breakers occurs due to condensation in the junction box, electrical connections should be moisture proofed by use of a coating or sealant.

STAND-OFF POSITIONING

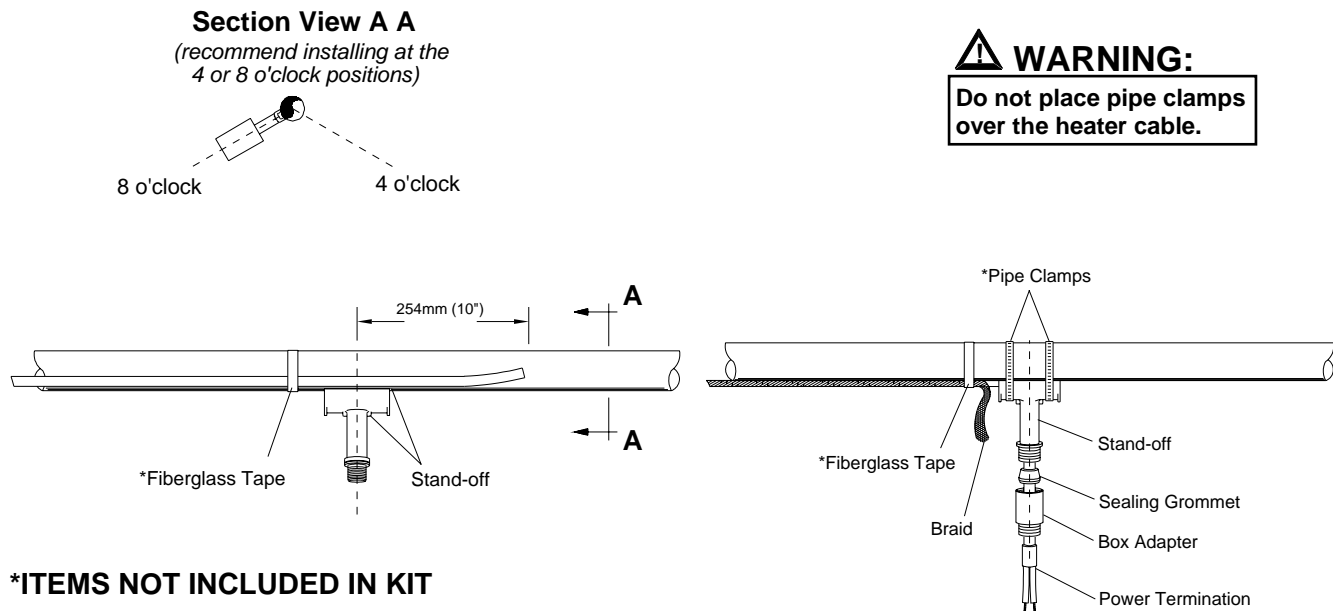


*ITEMS NOT INCLUDED IN KIT

- ❶ Mark pipe where stand-off will be mounted.
- ❷ **For External Braid Connection - CB Products only:**
 - Remove braid from heater cables, back to the point the cables leave the pipe. See Sheet 3.
 - Proceed to step 3 below.

For Internal Braid Connection - CB, J or JT Products:

- Proceed to step 3 below.



- ❸ Push heater cable through the bottom opening of stand-off.
- ❹ Place stand-off on pipe and fasten with pipe clamps.
- ❺ Slide the sealing grommet over heater cable and position inside stand-off opening.
- ❻ Apply silicone around the heater cable on top of the sealing grommet and fill any voids in sealing grommet.
- ❼ Slide the box adapter over the heater cable and tighten securely to stand-off.
- ❽ Prepare heater cable for power termination:
 - for braided products, see sheet 3.
 - for overjacket products, see sheet 4.
 - for base products, see sheet 5.
- ❾ Terminate heater cable, see sheet 7.

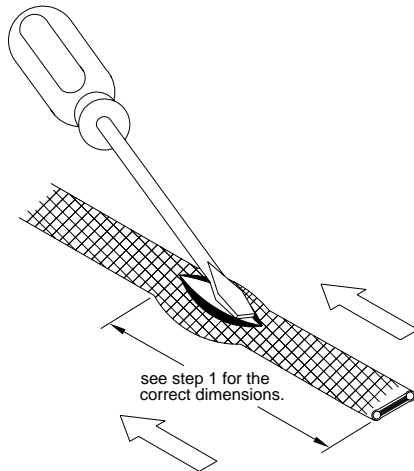BRAIDED PRODUCTS**1 For External Braid Connection:**


Move braid back 305mm (12") to create a bulge.

For Internal Braid Connection:


Move braid back 127mm (5") to create a bulge.

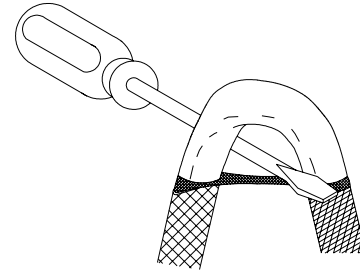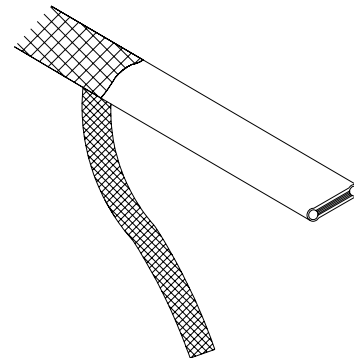2 At the bulge, separate the braid to make an opening.**3** While bending the heater cable, work it through the braid opening.**4** Pull the braid tight.**5** Proceed to "LT, CLT & HLT Products", sheet 5.


OVERJACKET PRODUCTS

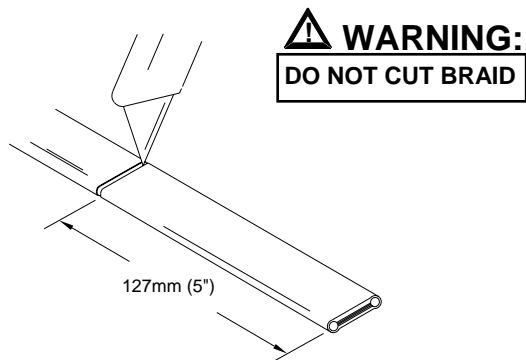


- ❶ Lightly cut around heater overjacket 127mm (5") from the end. Bend cable to break overjacket.
- ❷ Lightly cut overjacket up the center between first cut mark and the cable end. Bend cable to break overjacket.

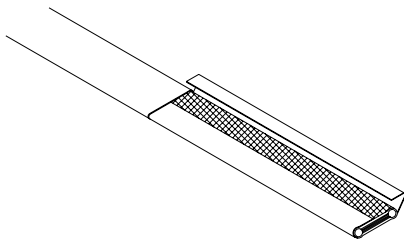


- ❸ Remove overjacket from heater cable.

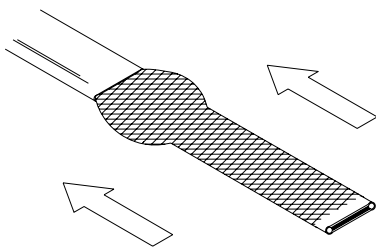


- ❹ Move braid back toward the overjacket, creating a bulge.

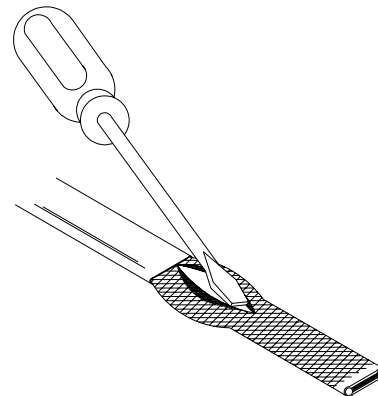

- ❺ At the bulge, separate the braid to make an opening.

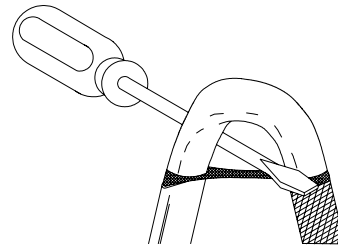


- ❻ While bending the heater cable, work it through the braid opening.

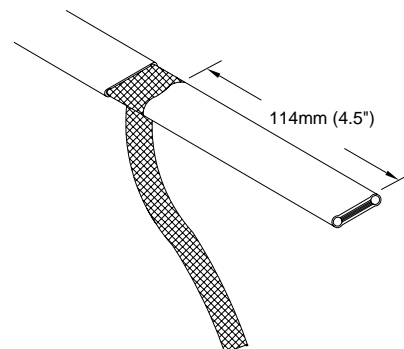


- ❼ Pull the braid tight.
- ❽ Proceed to "LT, CLT & HLT Products", sheet 5.

BASE LT, CLT & HLT PRODUCTS


(See sheet 6 for an alternate method of HLT products.)

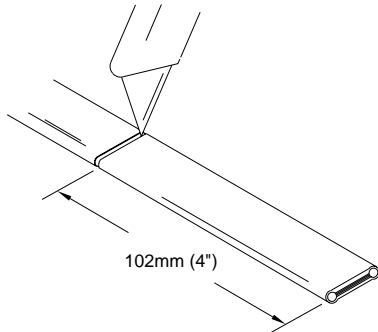


- ❶ Lightly cut around heater outer jacket 102mm (4") from the end. Bend cable to break outer jacket.
- ❷ Lightly cut the outer jacket up the center between the first cut mark & the cable end. Bend cable to break outer jacket.

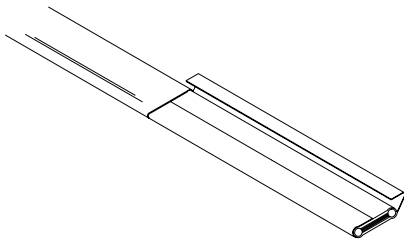


- ❸ Remove the jacket from the heater cable.

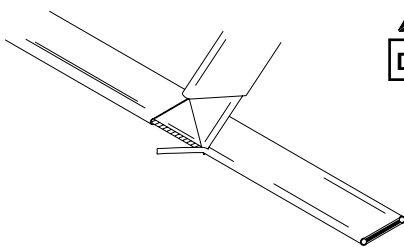

- ❹ Shave the core material from the outside of each bus wire.

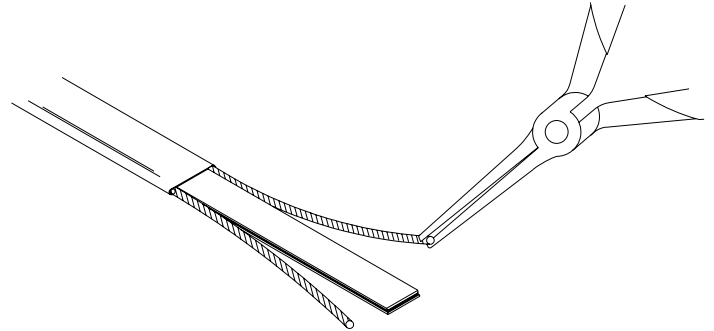


- ❺ Starting at the end, pull each bus wire away from the core material.

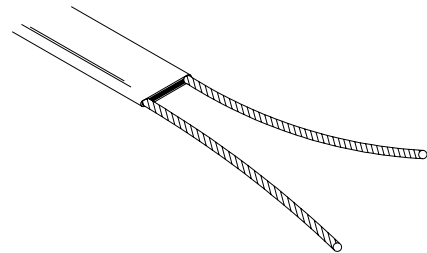

- ❻ Remove exposed core material.
- ❼ Cut 6mm (0.25") off the end of each bus wire.
- ❽ Proceed to "Power Termination", sheet 7.


⚠ WARNING:
DO NOT CUT BUS WIRES

HLT PRODUCTS ALTERNATE METHOD

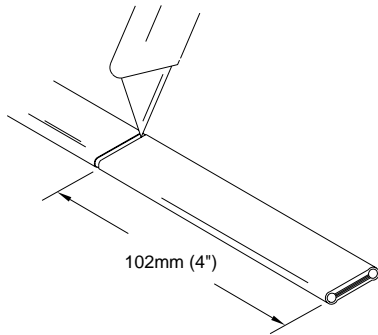


- ❶ Lightly cut around heater outer jacket 102mm (4") from the end. Bend cable to break outer jacket.


- ❷ Lightly cut the outer jacket up the center between the first cut mark & the cable end. Bend cable to break outer jacket.

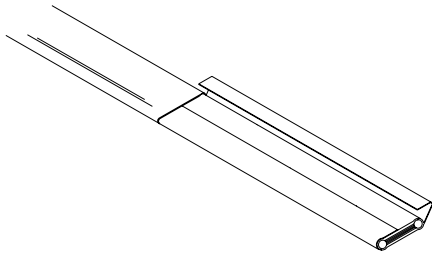


- ❸ Remove the jacket from the heater cable.

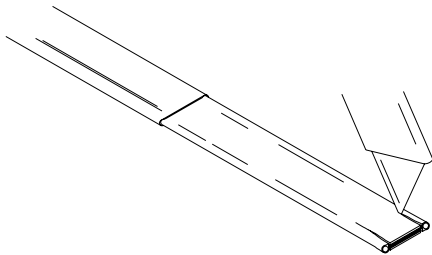


- ❹ Make a cut inside each bus wire.

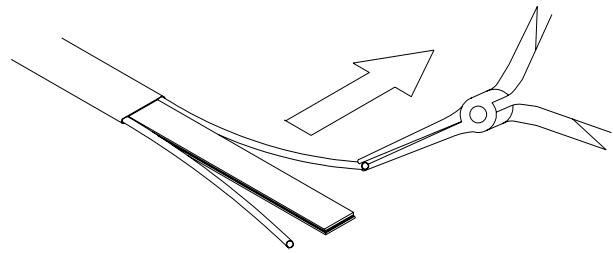

- ❺ Starting at the end, in the same plane as the cable, pull each bus wire away from the core material.

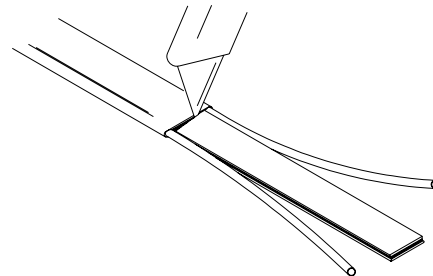

- ❻ Remove exposed core material.

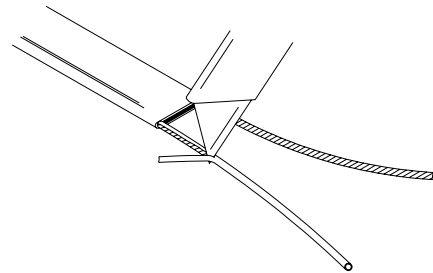


- ❼ Remove the remaining core material off the outside of each bus wire.

- ❽ Cut 6mm (0.25") off the end of each bus wire.


- ❾ Proceed to "Power Termination", sheet 7.

POWER TERMINATION**⚠ WARNING:**


- Bus wires must not touch or cross while inserting into power termination / end seal.
- Only power terminations / end seals specifically approved for the vendor's style and type of heater cable must be used.

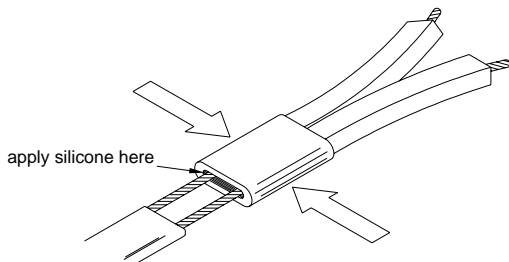

- 1 Insert bus wires into power termination.
- 2 Squeeze power termination opening and fill with silicone.

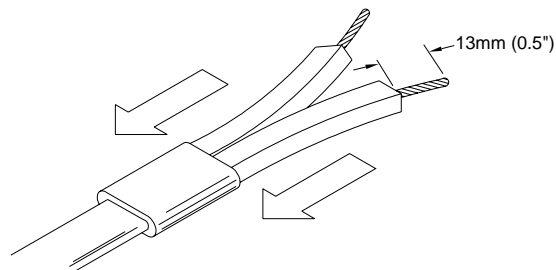

- 3 Push power termination to overlap jacket.
- 4 At this point, if you're installing the end seal, see the "End Seal" section below. Otherwise, proceed to "Power Connection", sheet 8.

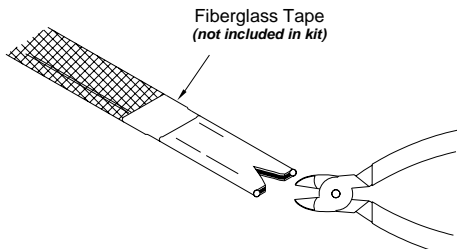
END SEAL

- 1 **Braided Products:**
Cut braid back 25mm (1") & tape in place with fiberglass tape (not included in kit).

Overjacket Products:

Remove 13mm (0.5") of overjacket exposing the braid, then remove the 13mm (0.5") of exposed braid.

- 2 Make a 10mm (0.4") cut at the end of the heater cable.

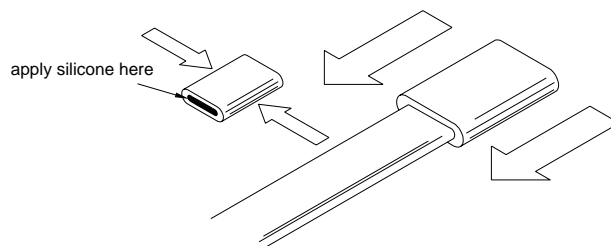

- 3 Squeeze the end seal and fill with silicone.
- 4 Push end seal over the heater cable.

Overjacket Products:


The end seal should overlap the overjacket.

- 5 The silicone will set up in about 30 minutes with a complete cure after 24 hours.
- 6 Proceed to "Power Connection", sheet 8.

⚠ WARNING:

- Do not megger or hi-pot until silicone is completely cured.
- Braid must be kept away from bus wires or shorting will occur.

POWER CONNECTION

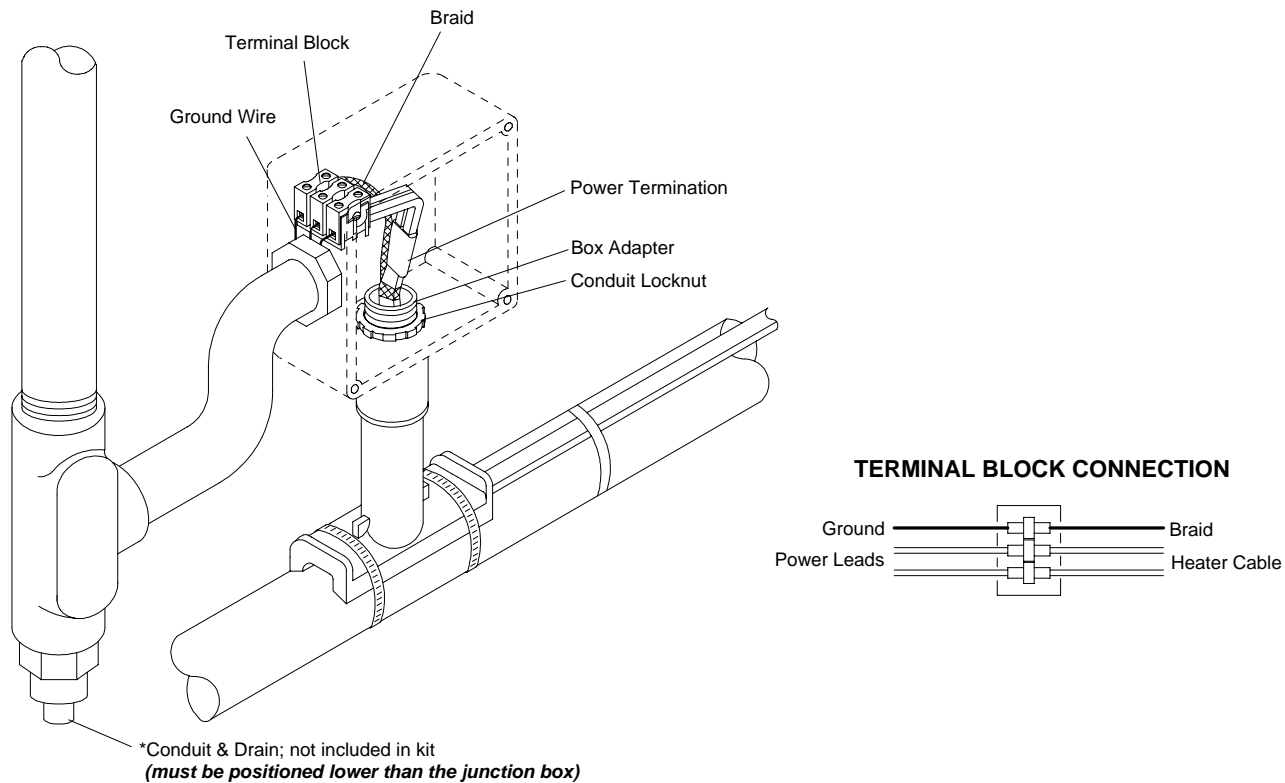

Note: This detail shows internal grounding of braid.

- ① Place gasket on box adapter.
- ② Position junction box on box adapter and secure it with the conduit locknut.
- ③ Connect bus and power wiring together using crimp connectors. *See diagram above.*
- ④ Ground connection:

For External Ground Connected Heaters:

- Connect ground braid to the ground wire using the uninsulated splice connector. *See diagram on sheet 1.*

For Internal Ground Connected Heaters:

- Connect ground wire and braid to the terminal block. *See diagram above.*

⑤ For Overjacket J or JT Products Only:

Apply silicone at point braid leaves the overjacket

- ⑥ Push all wires and cable inside junction box.
- ⑦ Place the box cover and box cover gasket onto the junction box.

Nelson Heat Tracing Systems products are supplied with a limited warranty. Complete Terms and Conditions may be found on Nelson's website at www.nelsonheaters.com.

P.O. BOX 726 ■ TULSA, OK 74101 ■ TEL 918-627-5530 ■ FAX 918-641-7336 ■ www.nelsonheaters.com